


# Fire Extinguisher Inspection Process

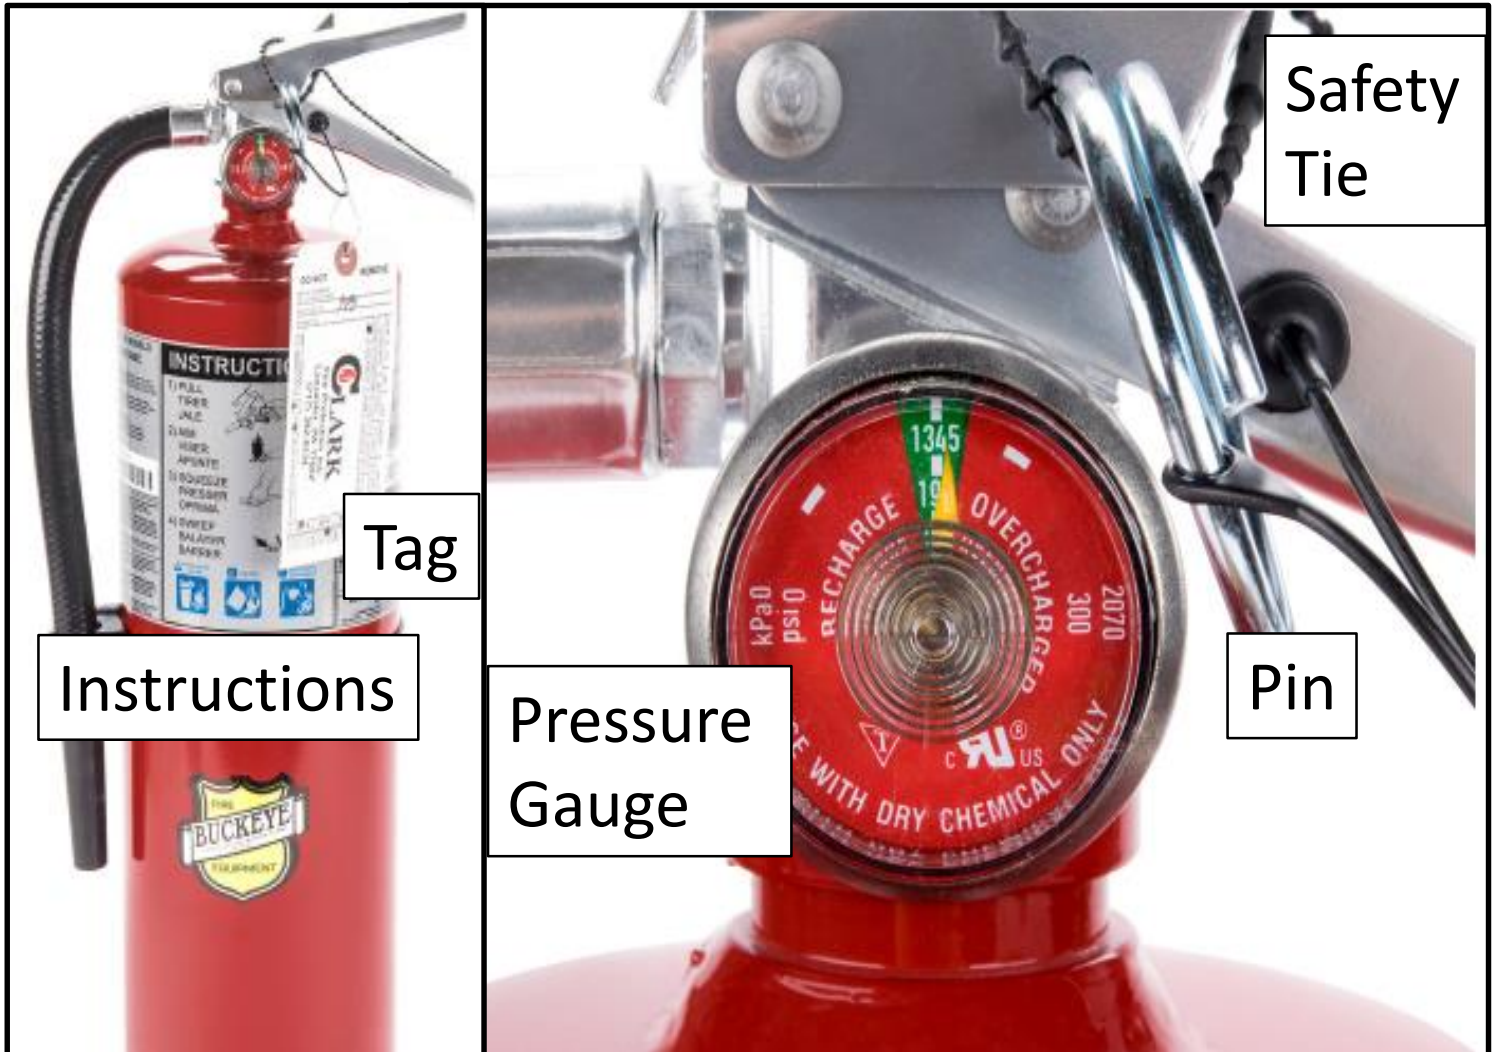

- Extinguisher is in designated location and unobstructed
- Locking pin is intact and secured by plastic tie
- Verify no physical damage, corrosion, leakage, or clogged nozzle
- Pressure gauge readings are in proper range
- Operating instruction and nameplate are facing forward
- Initial and date monthly inspection tag if not completed within the current month.